



DRIVE-OVER CURB, GUTTER AND SIDEWALK

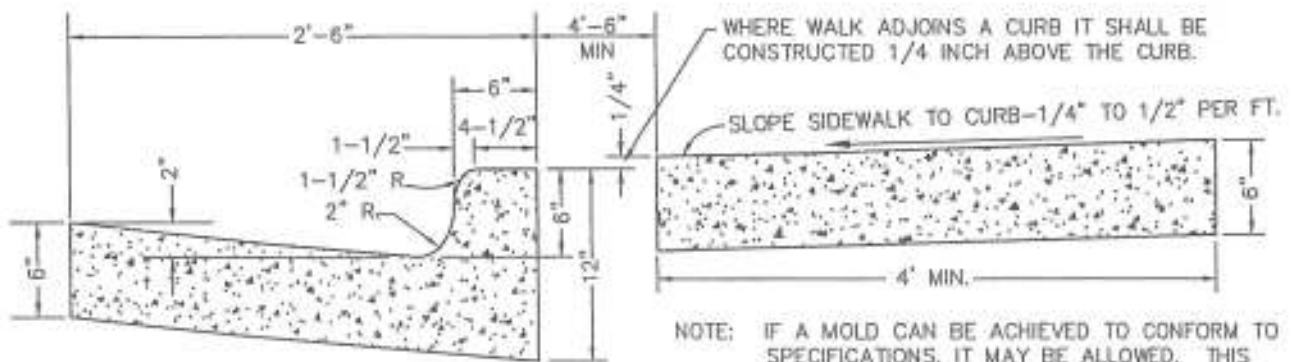

NOTE: IF A MOLD CAN BE ACHIEVED TO CONFORM TO SPECIFICATIONS, IT MAY BE ALLOWED. THIS WILL BE CONSIDERED ON A CASE BY CASE BASIS.


NOTE: IF NOT A MONOLITHIC POUR, THE VERTICAL CURB SHALL BE DOWELED TO THE SIDEWALK. DOWEL SHALL BE #4 REBAR @ 18" O.C. 3" INTO VERTICAL CURB AND 6" INTO SIDEWALK.

VERTICAL 6 INCH CURB, GUTTER AND SIDEWALK

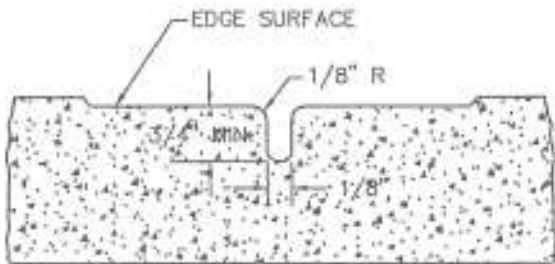

NOTE: JOINT SHALL BE CUT 1/4 THICKNESS OF CONCRETE INITIALLY

DUMMY JOINT FOR WALKS

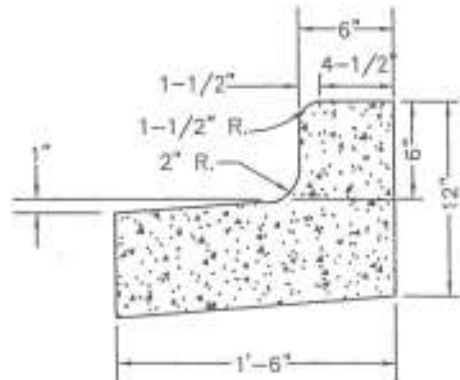

OUTFALL CURB AND GUTTER

TOWN OF JOHNSTOWN

CURB, GUTTER AND SIDEWALK DETAIL

TST